




- 1. PRECAST MANHOLE TO BE IN ACCORDANCE WITH LATEST ASTM DESIGNATION C-478,
- MINIMUM COMPRESSION STRENGTH TO BE 4000 PSI 2. FLEXIBLE RUBBER BOOT SHALL BE USED FOR CONNECTION OF PVC PIPE TO MANHOLE

SECTION A-A

PRECAST SANITARY MANHOLE TYPE 'A'

N.T.S.

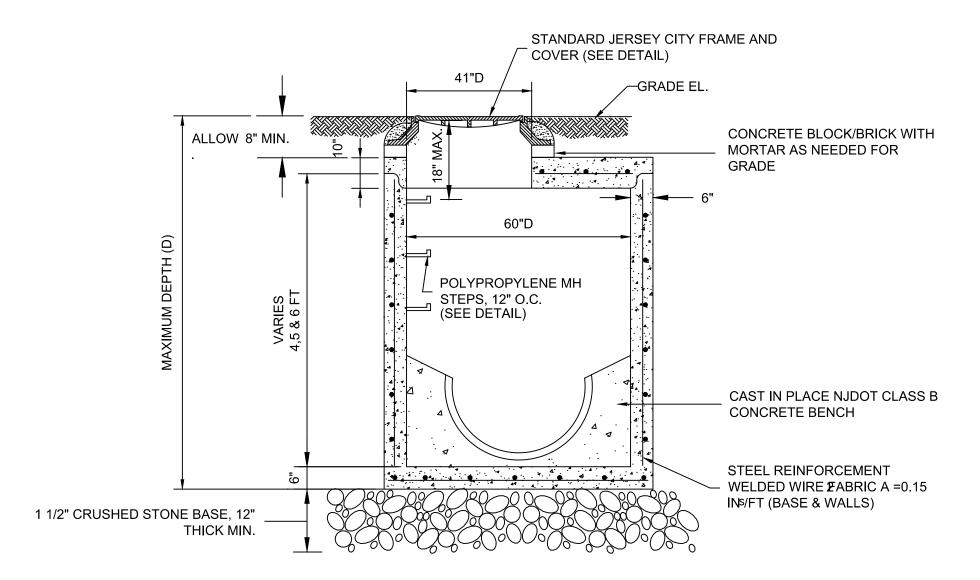


## **CONSTRUCTION NOTES:**

- 1. PRECAST MANHOLE TO BE IN ACCORDANCE WITH LATEST ASTM DESIGNATION C-478, MINIMUM COMPRESSION STRENGTH TO BE 4000 PSI
- 2. FLEXIBLE RUBBER BOOT SHALL BE USED FOR CONNECTION OF PVC PIPE TO MANHOLE

SECTION B-B

PRECAST SANITARY MANHOLE TYPE 'B'

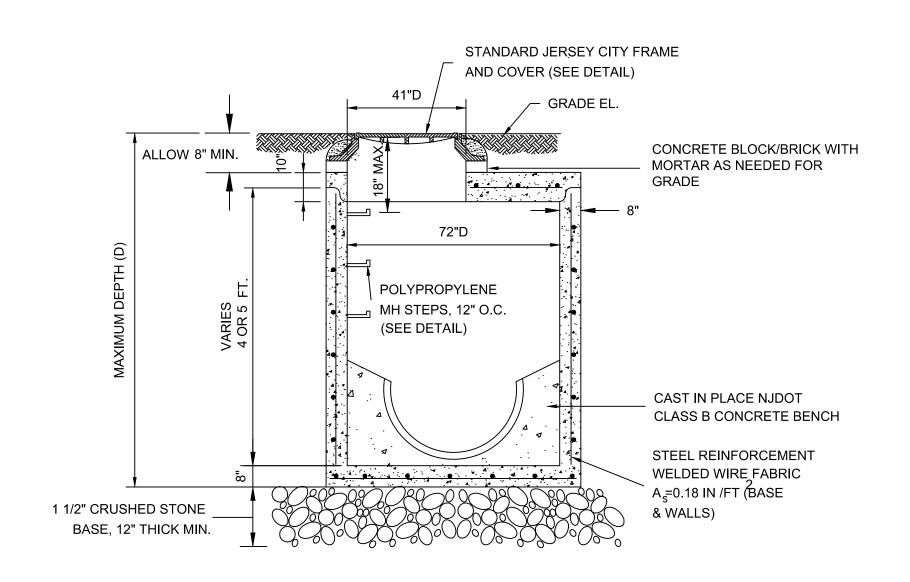

**CONSTRUCTION NOTES:** 

1. PRECAST MANHOLE TO BE IN ACCORDANCE WITH LATEST ASTM DESIGNATION C-478, MINIMUM COMPRESSION STRENGTH TO BE 4000 PSI 2. FLEXIBLE RUBBER BOOT SHALL BE USED FOR CONNECTION OF PVC PIPE TO MANHOLE

SECTION C-C

PRECAST SANITARY MANHOLE TYPE 'C'

City of Jersey City
Division of Architecture, Engineering,
Traffic and Transportation

13-15 LINDEN AVE. EAST JERSEY CITY, NEW JERSEY 07305 (201) 547-4412



1	Director Name Changed	6/10	
NO.	REVISIONS	DATE	
•			

